User:JUSTIN.HANES File:\\CFPUA-SHARES\DEPARTMENTS\ENGINEERS\2003_PROJECT MANAGEMENT DIVISION\2017 PROJECTS\314817.045-STANDARDS UPDATE\40 CFPUA DWG DETAILS\9 FINAL DETAIL DRAWINGS\CAD\PS-C4 FLOW METER-PLAN AND SECTION.DWG Scale:1:1 Plot Date:10/12/2018 Time:10:50 Justin Hanes; Layout:LAYOUT1

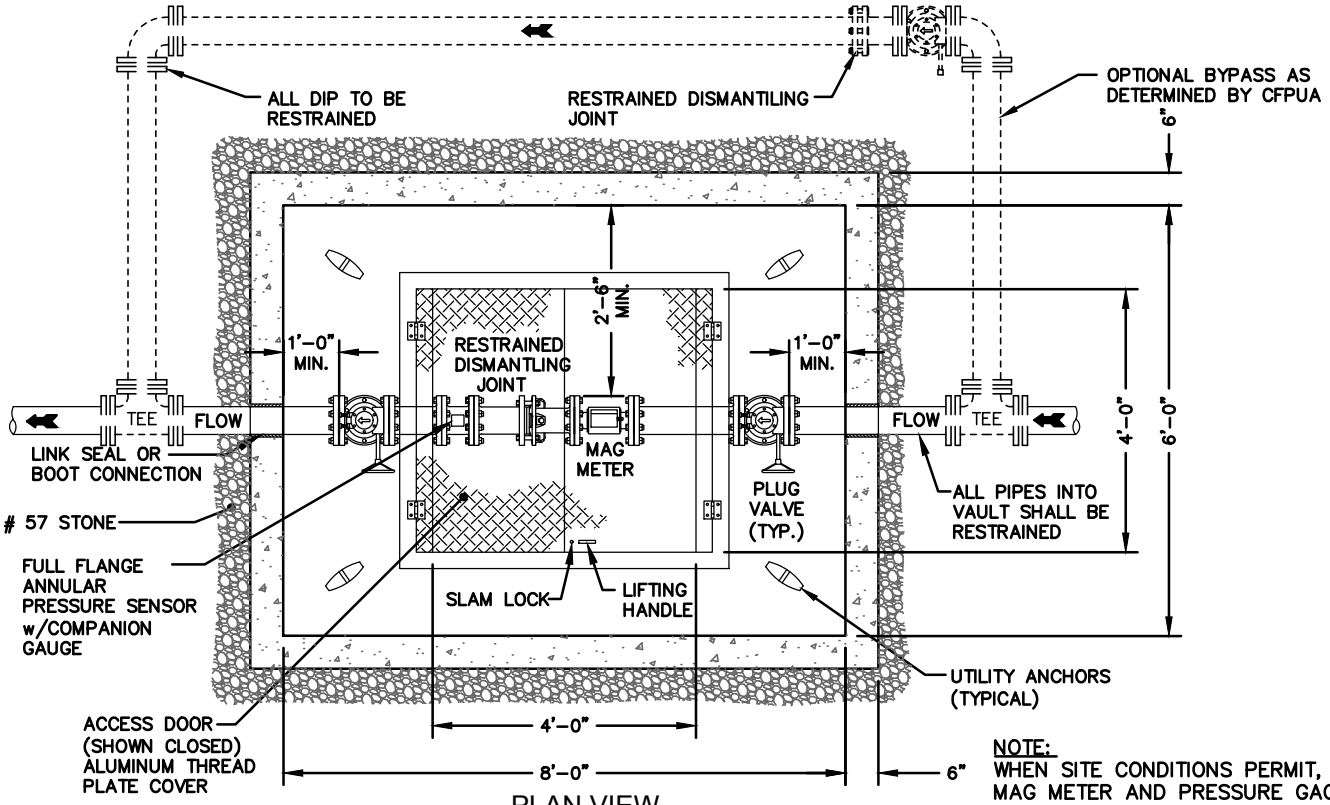

PLAN VIEW

NOTE:
WHEN SITE CONDITIONS PERMIT, THE MAG METER AND PRESSURE GAGE MAY BE LOCATED WITHIN AN EXTENDED VALVE VAULT ARRANGEMENT (PS=C2,3). IN EITHER CASE THE MAG METER MFG. REQUIREMENTS FOR UPSTREAM AND DOWNSTREAM STRAIGHT PIPE RUNS FROM METER SHALL BE MET.

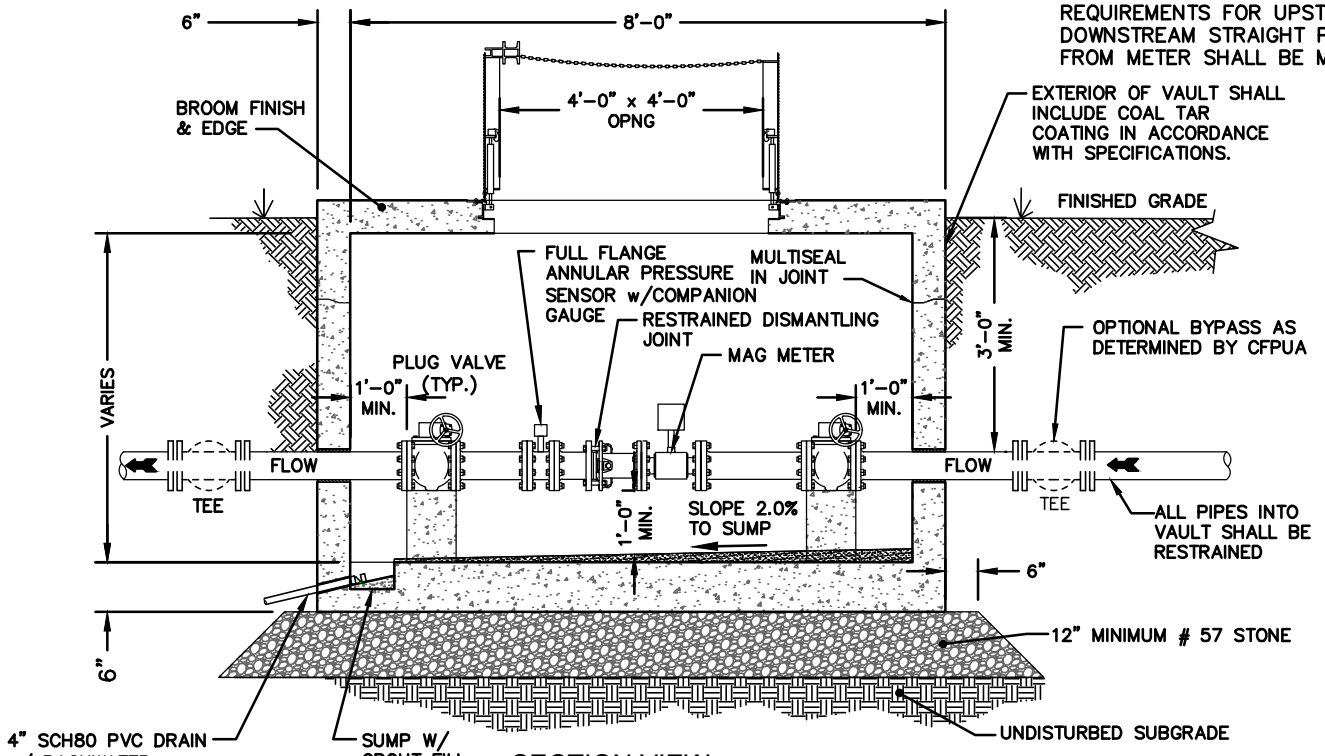

SECTION VIEW

MAG METER INSTALLATION DETAIL

NTS

DETAIL: **FLOW METER PLAN and SECTION**		DETAIL NO: **PS-C4**
SCALE: NOT TO SCALE	CFPUA DETAIL DATE: 01/01/19	SHEET NO: -
CFPUA REV. No: 1		

CAPE FEAR PUBLIC UTILITY AUTHORITY
235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: (910)332-6560
Stewardship. Sustainability. Service.