


User:JUSTIN.HANES File:\CFPUA-SHARES\DEPARTMENTS\ENGINEERS\2003\_PROJECT MANAGEMENT\DIVISION\2017 PROJECTS\14817\_045-STANDARDS UPDATE\40\_CFPUA\_DWG DETAILS\9 FINAL DETAIL DRAWINGS\CAD\ELECTRICAL\1704\_ELEC DETAILS.DWG Scale:1:1 Plot Date:1/7/2018 Time:08:22 Justin Hanes Layout:PS-E7 FRONT/ELEV

**NOTES:**

1. 120V CIRCUITRY; 3/4"C,#12 CONDUCTORS.
2. ANALOG LEVEL SENSING (IF APPLICABLE).
3. 4-20mA SIGNAL(S) (IF APPLICABLE); #18 TSP CABLE(S).
4. 4-20mA FLOW SIGNAL; 3/4"C, #18 TSP.
5. 8415 NOMINAL LUMENS, 4000K, SLIPFITTER, PHOTOCCELL; BEACON VPS SERIES, EATON NFFLD SERIES, OR HOLOPHAN PMLED SERIES.

ACTUAL EQUIPMENT LOCATIONS MAY VARY. EQUIPMENT CONFIGURATIONS MAY BE MIRRORED OR SHIFTED FROM WHAT IS SHOWN IN THIS DETAIL. REFER TO PLAN FOR ACTUAL INSTALLATION LOCATIONS.

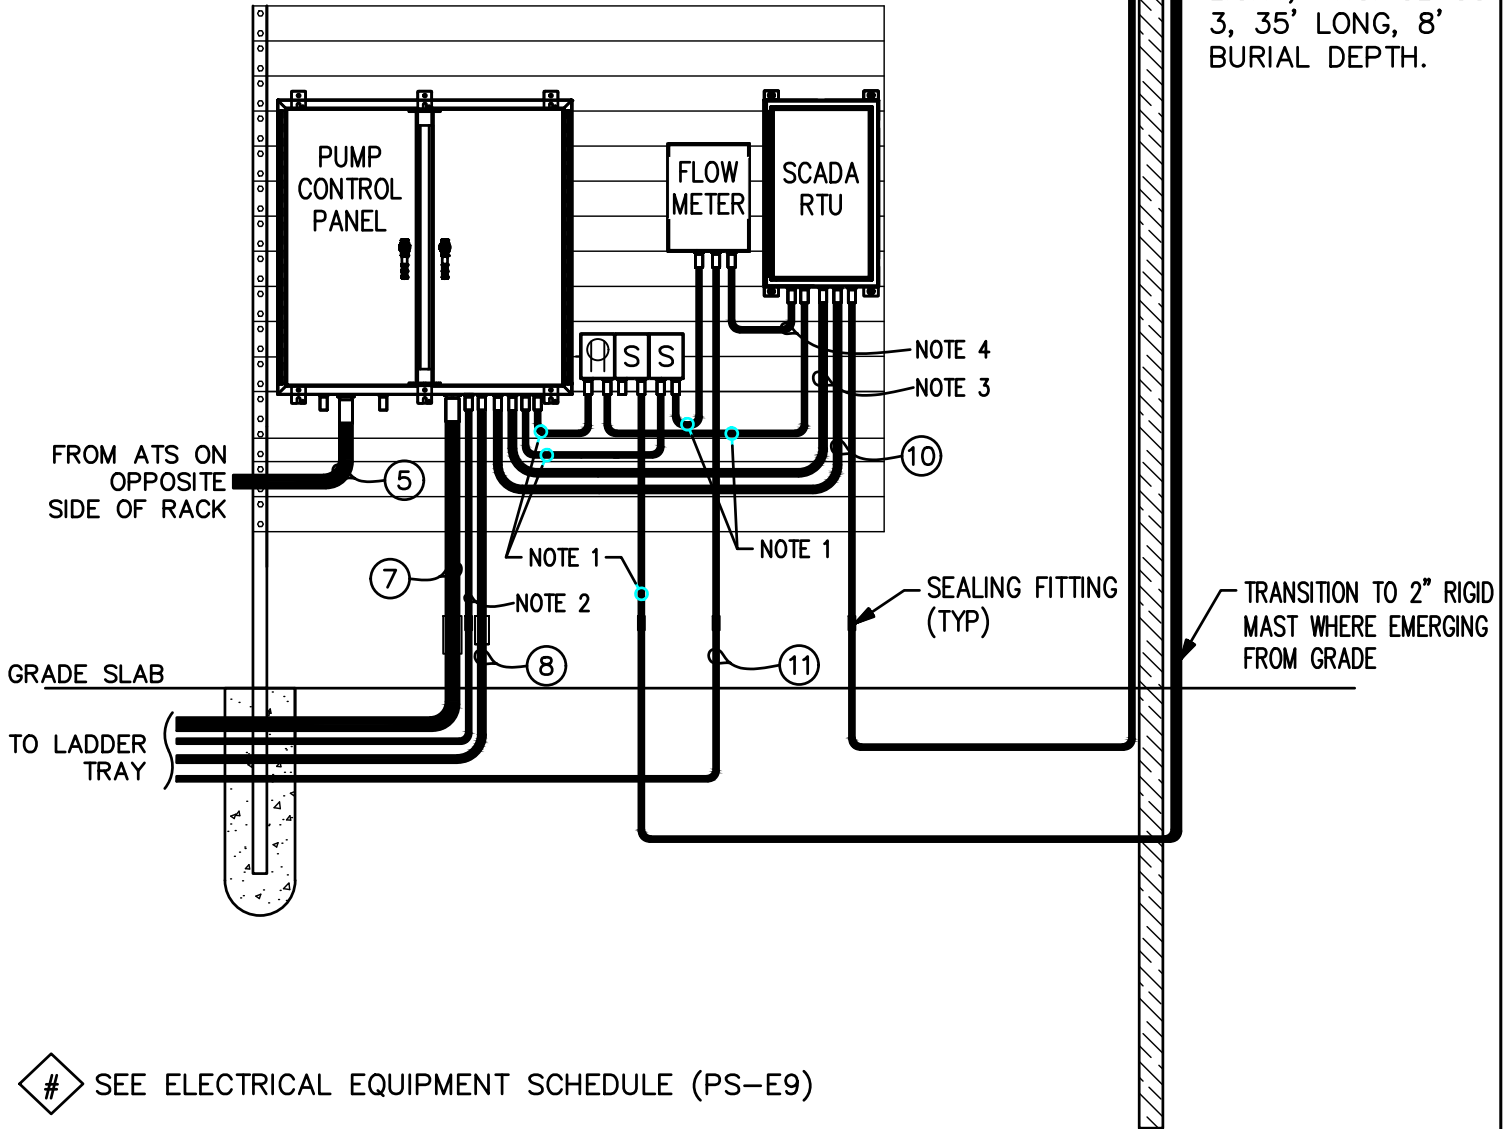

# SEE ELECTRICAL EQUIPMENT SCHEDULE (PS-E9)

Ⓢ SEE ELECTRICAL CIRCUIT SCHEDULE (PS-E10)

DETAIL: <b>FRONT EQUIPMENT &amp; CIRCUITRY ELEVATION</b>	
SCALE: NOT TO SCALE	CFPUA DETAIL DATE: 01/01/19
CFPUA REV. No: 1	



CAPE FEAR PUBLIC UTILITY AUTHORITY  
235 GOVERNMENT CENTER DRIVE  
WILMINGTON, NC 28403  
OFFICE: (910)332-6560

Stewardship. Sustainability. Service.

DETAIL NO: <b>PS-E7</b>
SHEET NO: -