


PLAN

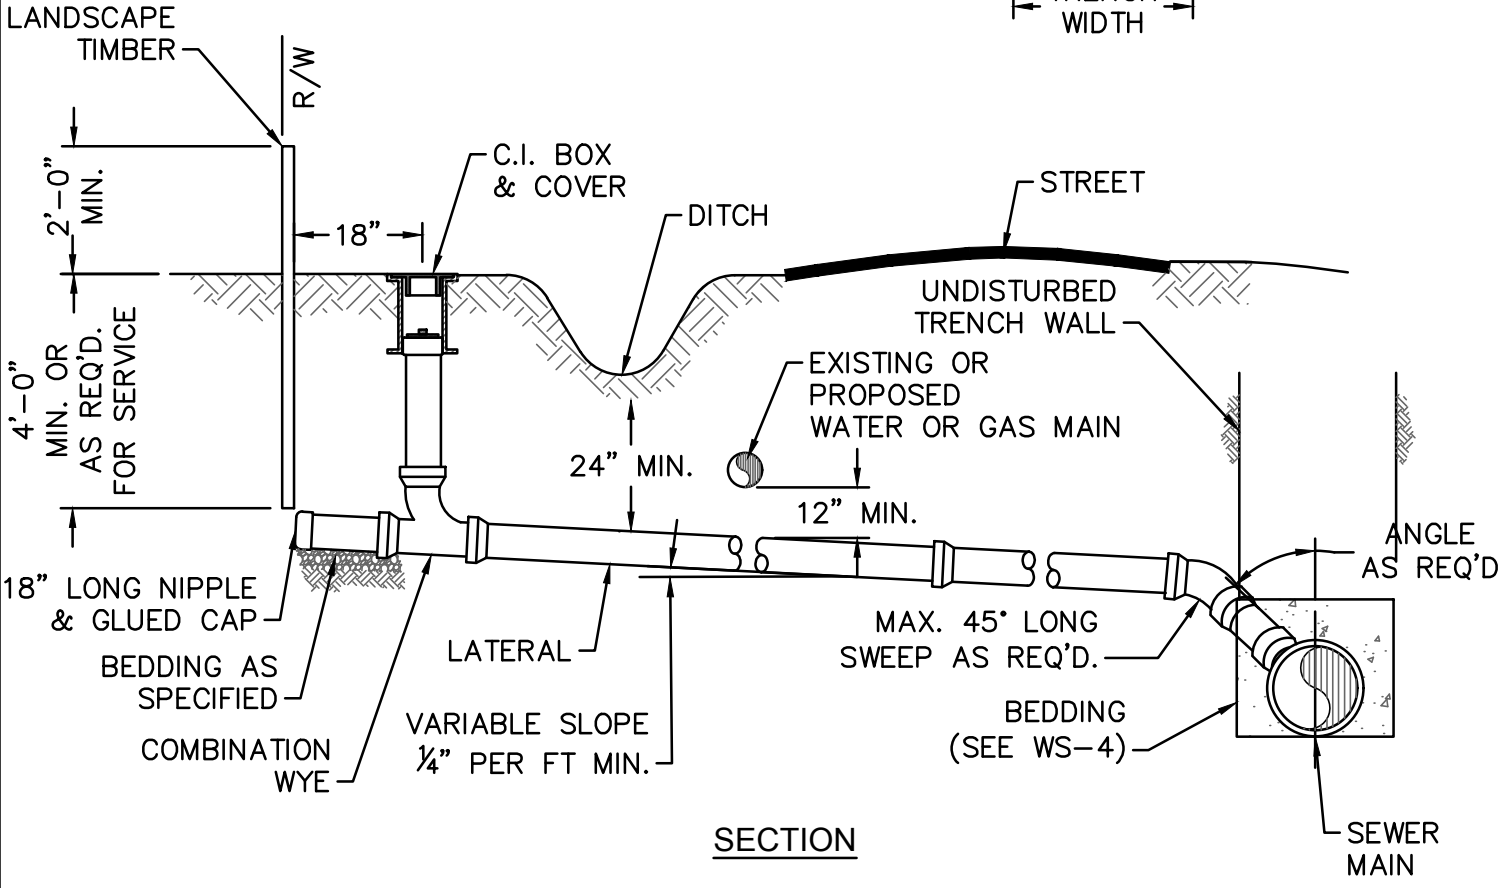

SECTION

NOTES:

1. SEWER SERVICES SHALL BE PERPENDICULAR TO MAIN. SEWER SERVICES IN CUL-DE-SACS ARE REQUIRED TO BE PERPENDICULAR, OR MUST ORIGINATE IN END OF LINE MANHOLE AND TERMINATE AT RIGHT-OF-WAY LINE.
2. ALL SERVICES CONNECTING INTO DUCTILE IRON MAINS SHALL BE CONSTRUCTED OF DIP, WITH PROTECTIVE LINING.
3. CLEANOUTS SHALL BE LOCATED A MINIMUM OF 12 FEET FROM ALL PROPERTY CORNERS.
4. MINIMUM 1'-6" NIPPLE SPACING BETWEEN FITTINGS.
5. FOR PRIVATE 8" SERVICES, MANHOLES ARE REQUIRED FOR CONNECTION TO MAIN.

DETAIL: SEWER SERVICE CONNECTION - LONG-SIDE		 <p>CAPE FEAR PUBLIC UTILITY AUTHORITY 235 GOVERNMENT CENTER DRIVE WILMINGTON, NC 28403 OFFICE: (910)332-6560</p>	DETAIL NO: S-10
SCALE: NOT TO SCALE	CFPUA DETAIL DATE: 01/01/19		SHEET NO: -
CFPUA REV. No: 1	Stewardship. Sustainability. Service.		