


PLAN

4" OR 6" DIA. X 1/8' BEND MAXIMUM LONG SWEEP

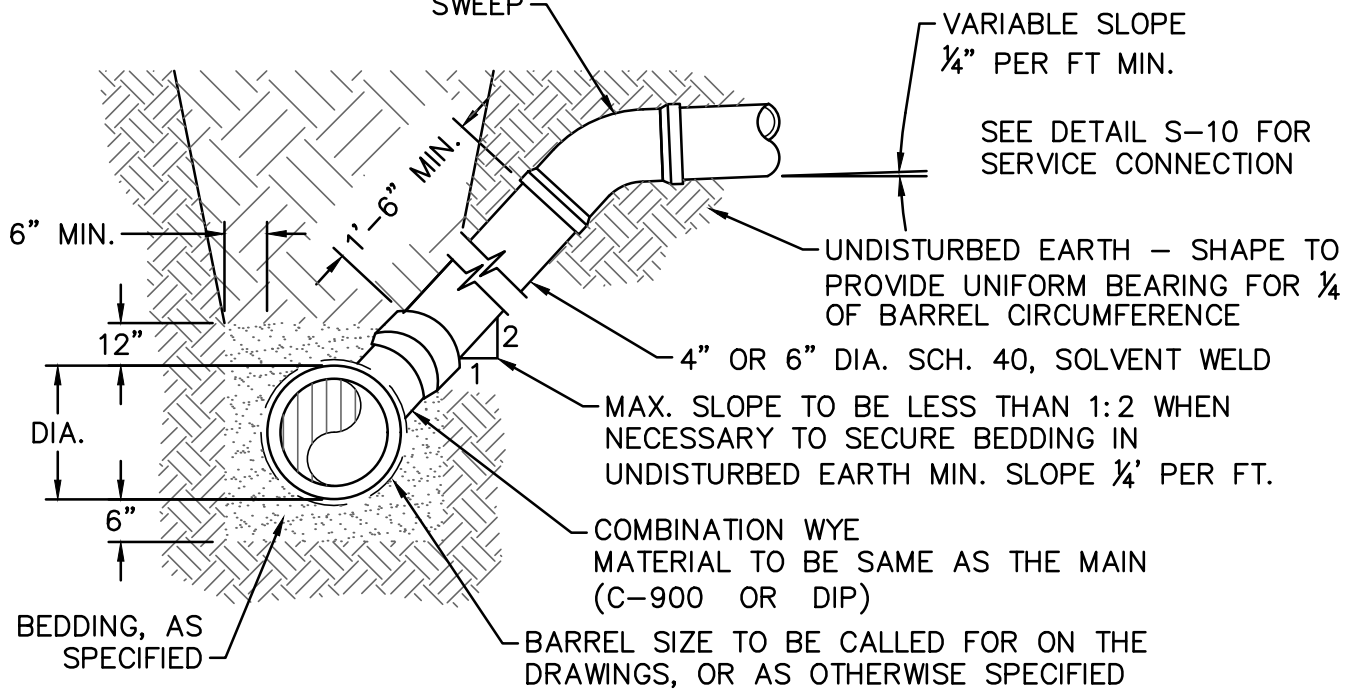

SECTION

NOTES:

1. FOR PRIVATE 8" SERVICES, MANHOLES ARE REQUIRED FOR CONNECTION TO SYSTEM AND AT THE PROPERTY LINE, WITH REQUIRED EASEMENT.
2. ALL SERVICES CONNECTING INTO DUCTILE IRON MAINS SHALL BE CONSTRUCTED OF DIP, WITH PROTECTIVE LINING.

DETAIL:
**SEWER SERVICE CONNECTION -
MAIN to LATERAL (LESS THAN 8' DEEP)**

SCALE: NOT TO SCALE CFPUA DETAIL DATE:

CFPUA REV. No: 1

01/01/19



CAPE FEAR PUBLIC UTILITY AUTHORITY
235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: (910)332-6560

Stewardship. Sustainability. Service.

DETAIL NO:

S-11

SHEET NO:

-