


User: JUSTIN.HANES File: \\CFPUA-SHARES\DEPARTMENTS\ENGINEERS\2003_PROJECT MANAGEMENT DIVISION\2017 PROJECTS\314817.045-STANDARDS UPDATE\40 CFPUA.DWG DETAILS\9 FINAL DETAIL DRAWINGS\CAD\WS-6 TRACER WIRE DETAIL.DWG Scale: 1:1 Plot Date: 11/29/2018 Time: 15:31 Justin Hanes Layout MODEL

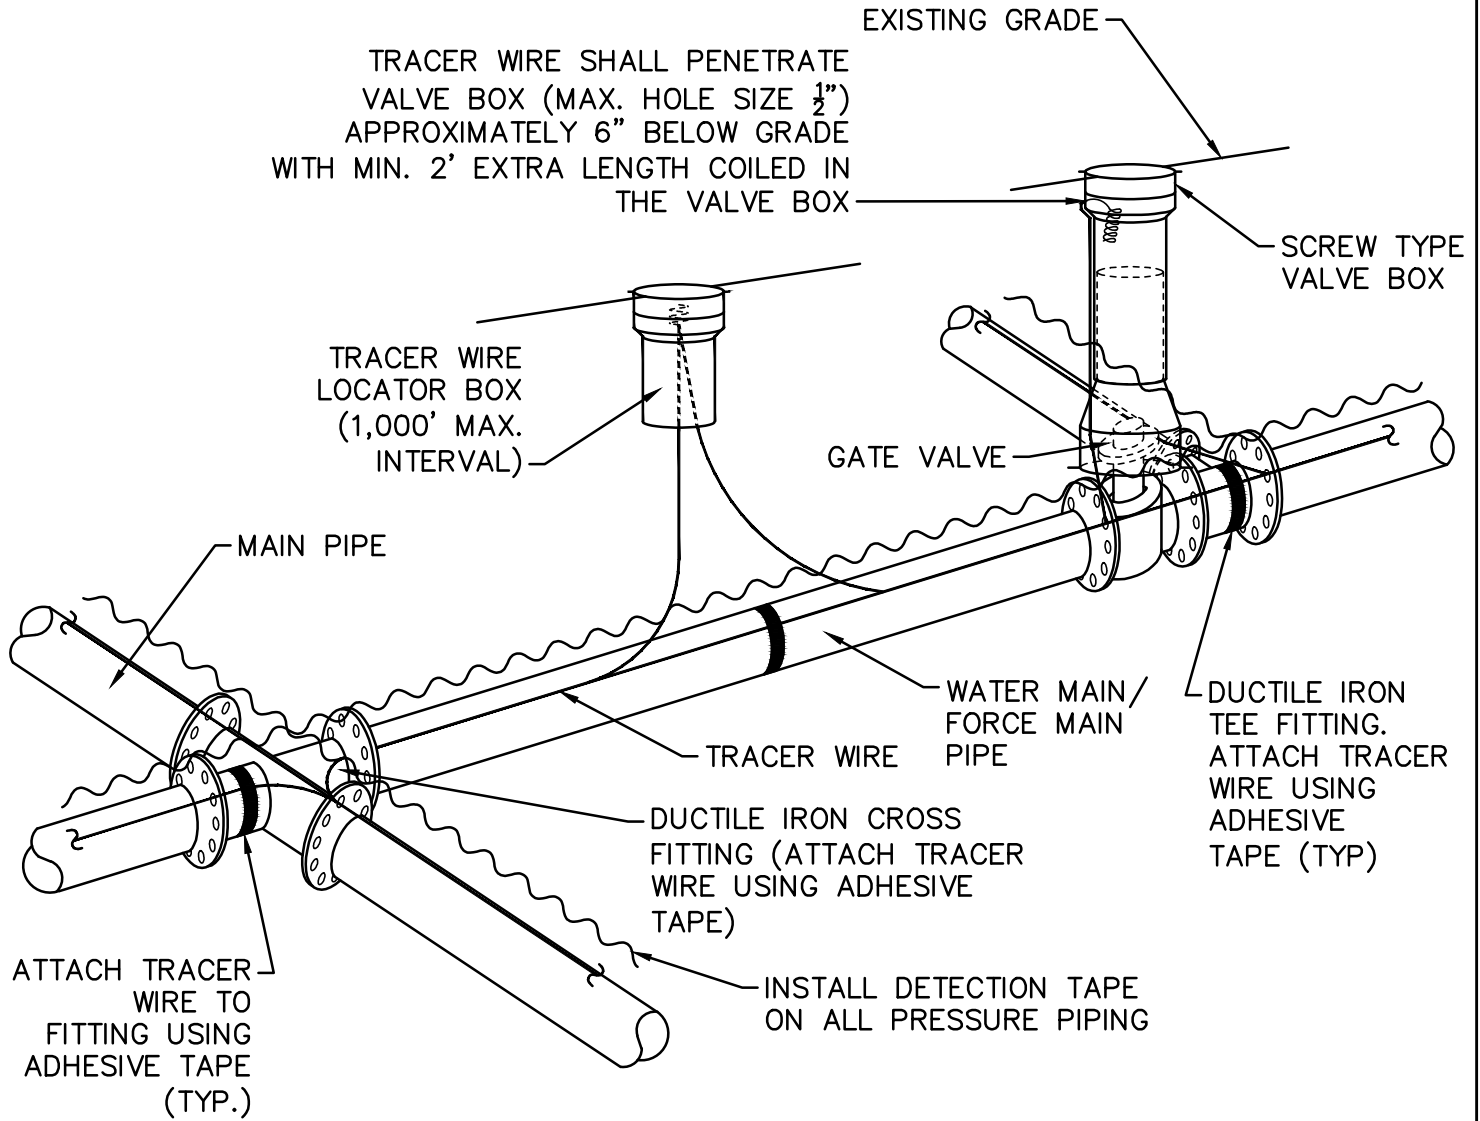

NOTES:

1. TRACER WIRE SHALL BE #10 COPPER SOLID CORE COPPER WIRE WITH GAS AND OIL RESISTANT INSULATION AND DIRECT BURY RATING.
2. WIRE SHALL BE STRAPPED TO ALL PVC PIPING WITH ADHESIVE TAPE AT 12 FOOT INTERVALS.
3. SECURE WIRE TO ALL TEE AND CROSS FITTINGS WITH ADHESIVE TAPE.
4. ALL SPLICES IN THE WIRE SHALL BE MADE WITH 3M DBR DIRECT BURY SPLICE KITS.

DETAIL: TRACER WIRE DETAIL		 CAPE FEAR PUBLIC UTILITY AUTHORITY 235 GOVERNMENT CENTER DRIVE WILMINGTON, NC 28403 OFFICE: (910)332-6560 Stewardship. Sustainability. Service.	DETAIL NO: WS-6
SCALE: NOT TO SCALE	CFPUA DETAIL DATE: 01/01/19		SHEET NO: -
CFPUA REV. No: 1			