


S:\TreatmentEng\CMV\Engineers\2003_Project Management\2017 Projects\Standards Update 314817.045\CFPUA Dwg Details\CADW-10 Fire Main Connection.dwg, 12/2/2024 1:29:56 PM, justin.hanes

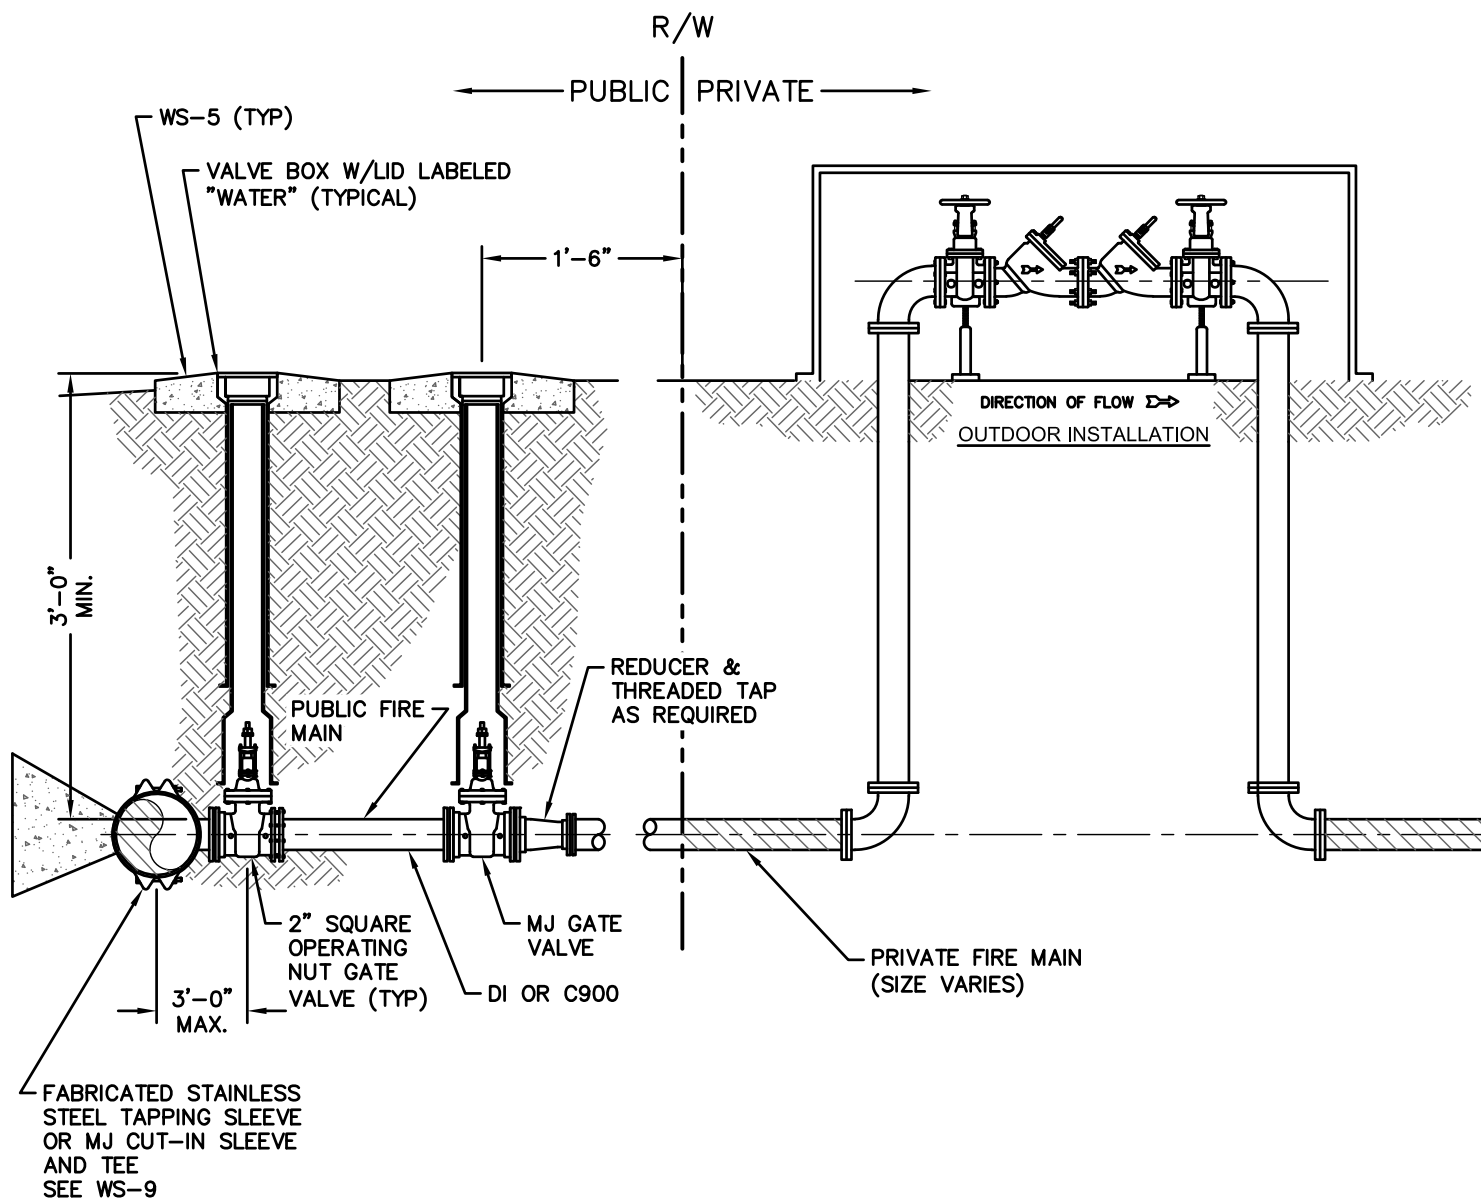

NOTES:

1. A GATE VALVE IS REQUIRED AT THE CFPUA FIRE MAIN TAP LOCATION.
2. WHEN THE FIRE MAIN IS FROM OPPOSITE SIDE OF NC-DOT ROAD OR CITY STREET, A SECOND VALVE IS REQUIRED 18" INSIDE PUBLIC R/W.
3. IF TAPPING VALVE IS LESS THAN 5-FEET FROM R/W THEN SECOND VALVE AT R/W IS NOT REQUIRED.

DETAIL:

FIRE MAIN CONNECTION

SCALE: NOT TO SCALE

CFPUA DETAIL DATE:

01/01/2025



CAPE FEAR PUBLIC UTILITY AUTHORITY
235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: (910)332-6560

DETAIL NO:

W-10

SHEET NO:

-